


SCHEMATIC DIAGRAM

13



NOTE
ALL VOLTAGES MEASURED FROM PC BOARD GROUND WITH D.C. VTM AT NO SIGNAL (AT 13.8V POWER SUPPLY) IF MEASUREMENT VALUES OBTAINED ARE IN EXCESS OF ±20% OF VALUES SHOWN, THEN REASON FOR DIFFERENCE SHOULD BE CORRECTED
Δ TX : □ LSB : () AM TX
⊕ CHASSIS GND
* PC BOARD GND
* VARIABLE

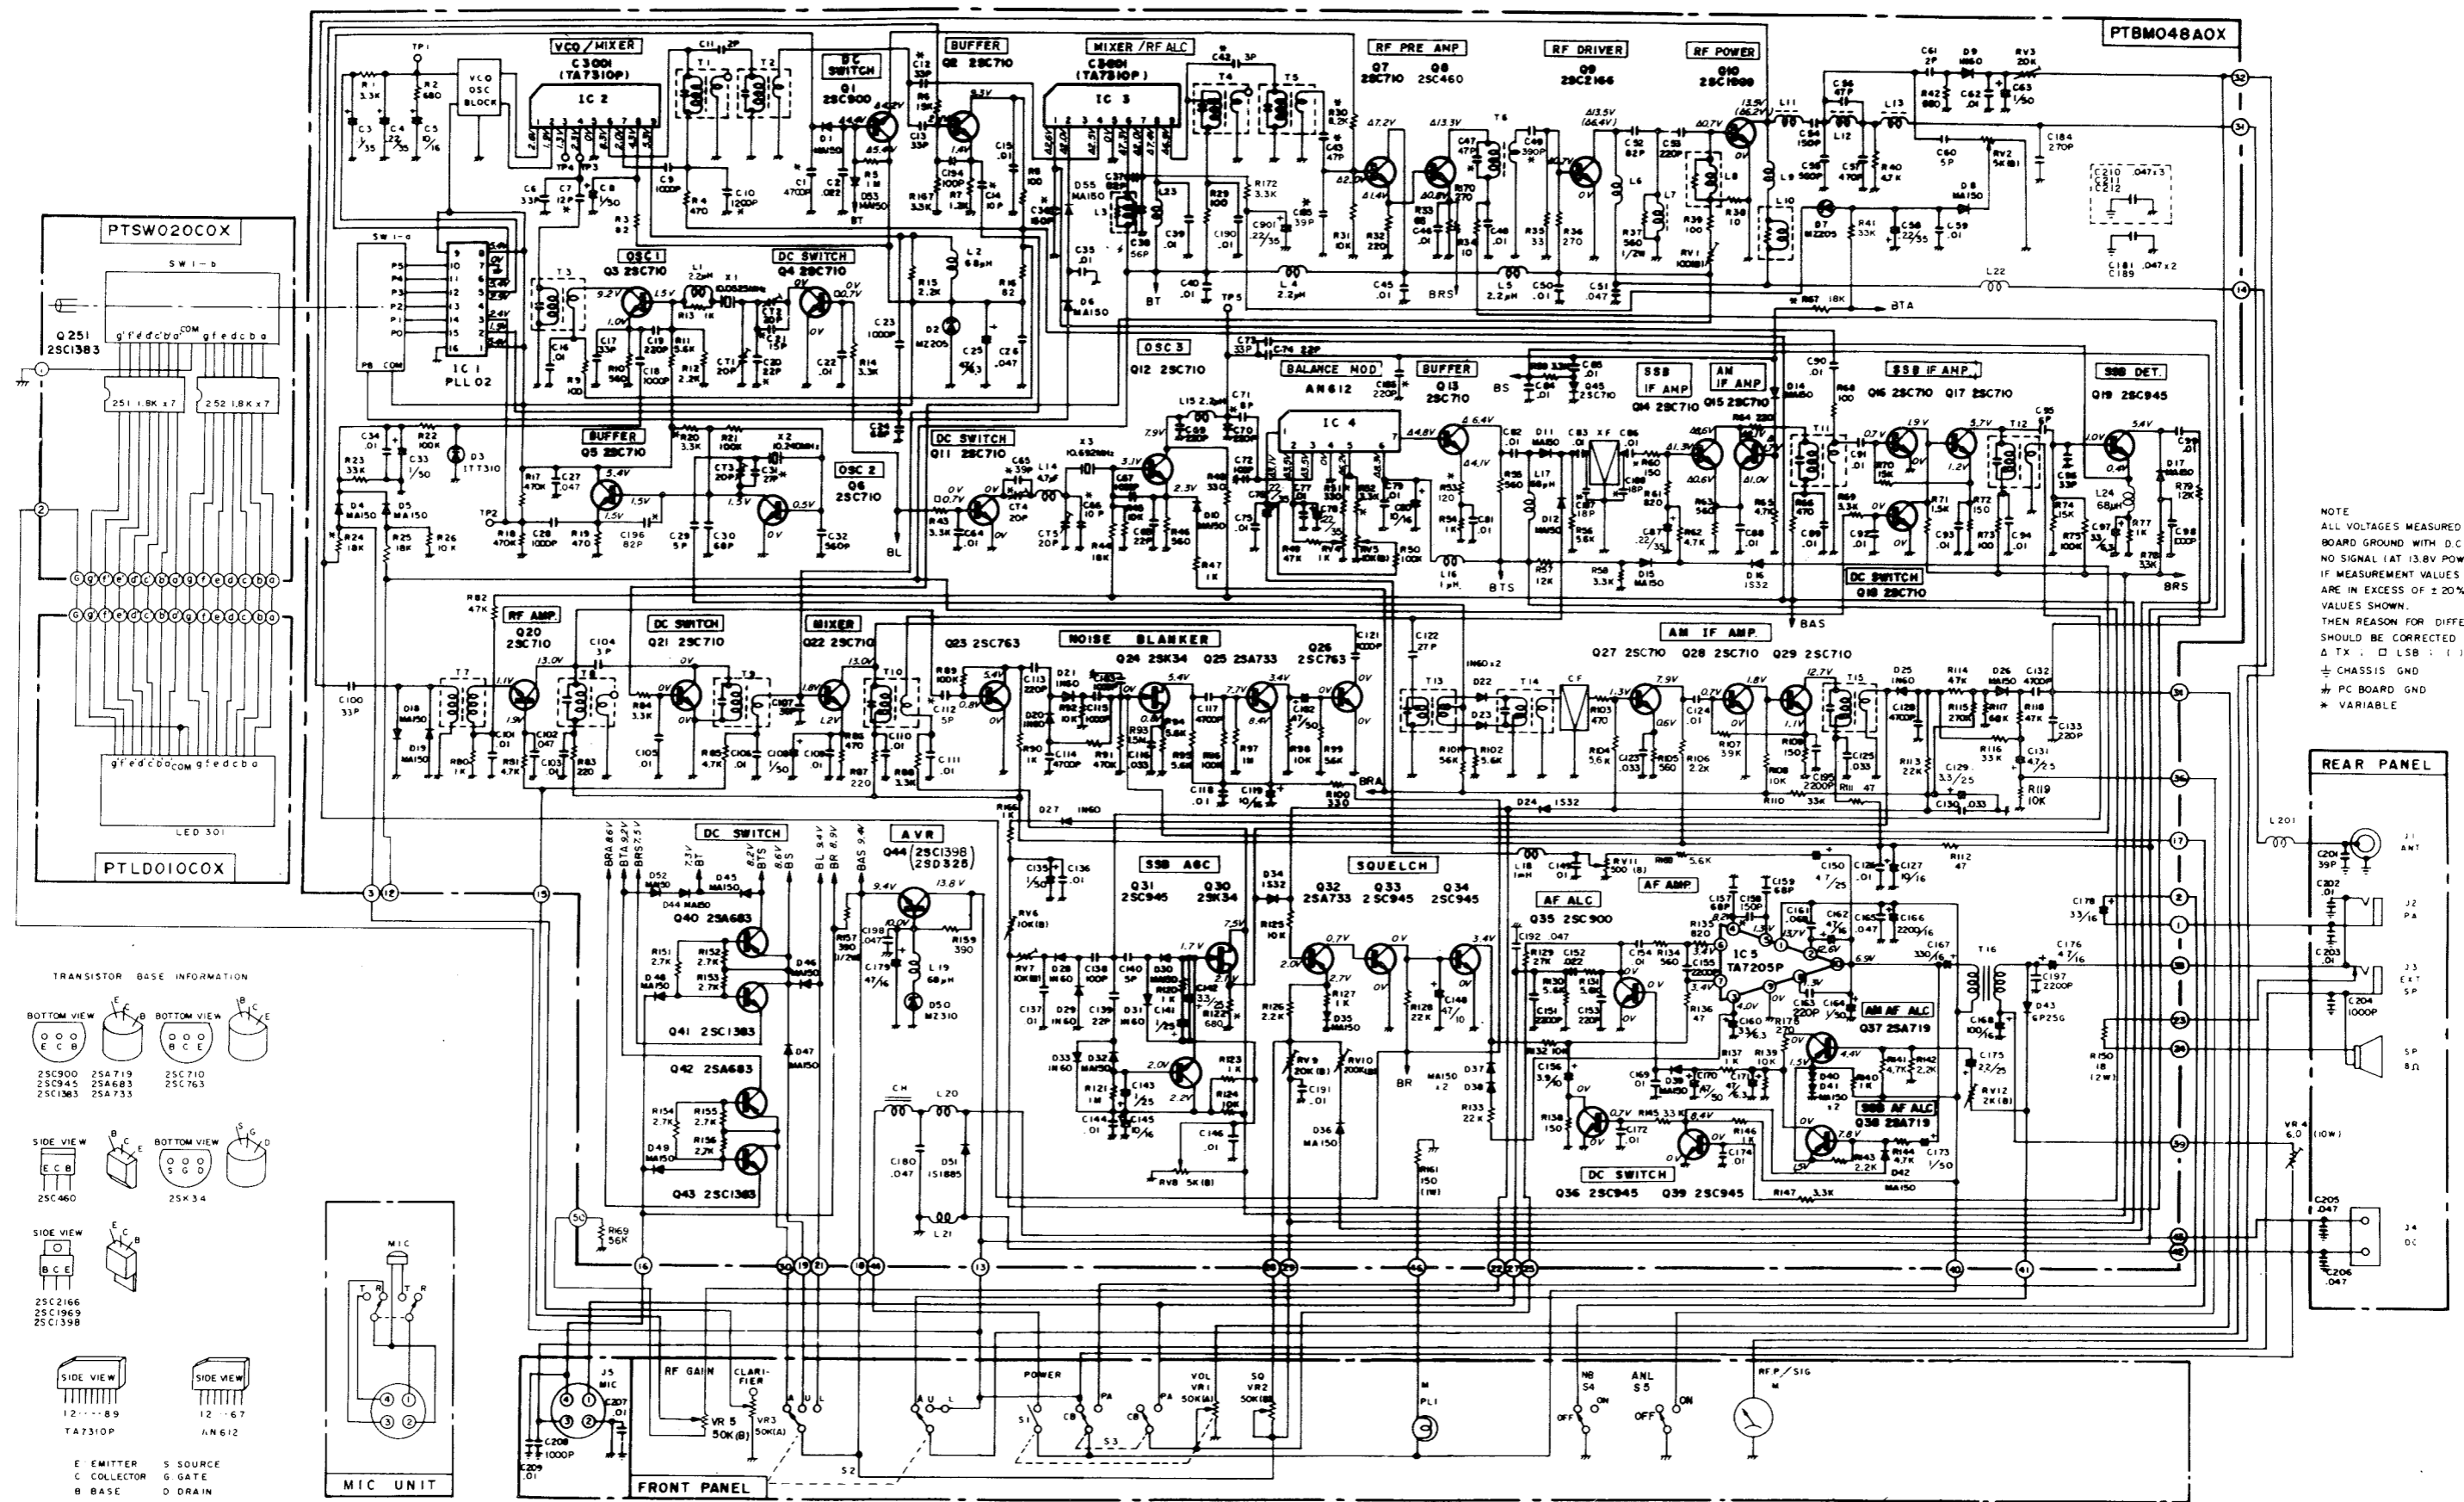